

BILL OF MATERIALS

NO.	NOMENCLATURE	REQ'D.
1	PIPE, 2" MAINLINE - P.V.C.*	
2	PLUG, 2" BRASS	1
3	NIPPLE, 1" x 2", BRASS	1
4	VALVE, 1" BALL, B11-444 ^o	1
5	NIPPLE, 1" X 6", BRASS	1
6	WIRE, #10 SOLID COPPER, BLUE COATED, EXTEND MIN.18" INTO BOX, NEAR LID	
7	PIPE, 1" PE 3408, SDR 7, 200 P.S.I.	
8	CAP, 1" P.V.C.	1
9	TRAFFIC RATED METER BOX AND LID (MD-STATES PLASTIC, INC. MSBCF 1324-18 NOT FOR THROUGH-WAY TRAFFIC APPLICATION) ^o	1
10	CASING, 6" P.V.C. SEWER PIPE	1
11	ADAPTER, BRASS PAK JOINT, 2" M.I.P.T. x 2" P.V.C.	1
12	MARKER, BLUE, CARSONITE #CWV-116	1
13	ADAPTER, BRASS PAK JOINT, 1" M.I.P.T. x POLY	2
14	ELL, 1" BRASS, 90'	1
15	TEE, 2" BRASS	1
16	INSERT, STIFFENER, 1" (FORD #72) ^o	2
17	CONCRETE BLOCKING	
18	BUSHING, BRASS 2x1	1
19	INSERT, STIFFENER, 2" (FORD #75) (IF POLY ONLY)	



^o OR EQUIVALENT APPROVED BY THE DISTRICT

* IF MAINLINE IS P.E., #11 ABOVE WILL CHANGE AND #19 WILL BE REQUIRED.

ALL BRASS FITTINGS TO BE LEAD FREE DOMESTIC BRASS PER UNITED STATES BILL S.3874.

NOTES:

1. BLOCK AS PER P.U.D. HORIZONTAL THRUST BLOCKING DETAIL. BEARING AREA TO BE AGAINST UNDISTURBED EARTH AND TO BE DETERMINED BY THE ENGINEER. USE FORMING AS NECESSARY TO PREVENT CONCRETE FROM INTERFERING WITH CAP OR PLUG.
2. PLASTIC THREADED CAPS TO BE HAND TIGHT ONLY.

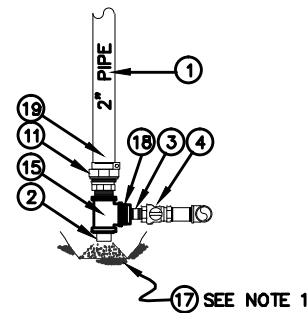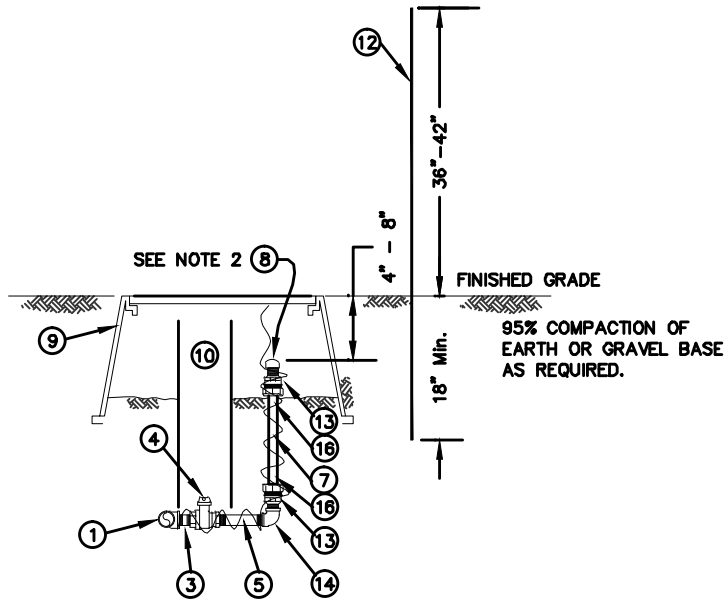


 PUD NO. 1 OF SKAGIT COUNTY ENGINEERING MANAGER
 APPROVED ON: _____ MAY 16 _____, 2014



STANDARD
1" FLUSHING ASSEMBLY

SCALE: 1" = 2'
 DATE: 3-25-05
 REVISED: 5/16/14
 DRAWN BY: CAS
 APPROVED BY: GJS

STANDARD
WB1-1